

WASH Site Profile - Camp 6

Ukhiya, Cox's Bazar, Bangladesh (February 2018) GPS Coordinates: 92.15685815 21.20395533



Summary

This profile provides an overview of water, sanitation and hygiene (WASH) infrastructure within Camp 6 in Ukhiya, Cox's Bazar. Primary data for this round was collected between 4-20 February 2018.¹ Findings should be considered indicative only.

of individuals:27241# of latrines
(% functional):# of households:6114% of safe latrines# of shelters:5061# of handpumps
(% functional):# of individuals5(% functional):per shelter:# of washrooms:

Site Overview

Key WASH Infrastructure # of latrines 775 (92%) (% functional): % of safe latrines²: 95%


226 (86%)

336

Location Map



Access to Water

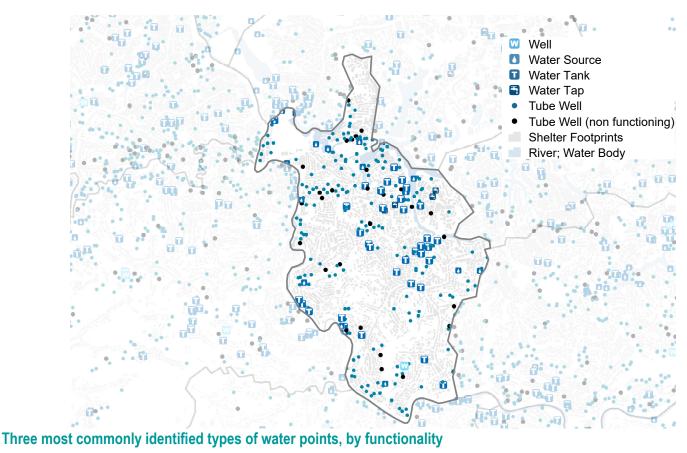



Targets based on WASH Sector Standards/Indicators for the Rohingya response, Sphere Minimum Standards/Indicators as well as Department of Public Health and Environment (DPHE) Minimum Standards/Indicators • Minimum standard/indicator reached, • 75%-99% minimum standard/indicator reached, • 50-74% minimum standard/indicator reached, • Less than 50% of minimum standard/indicator reached

¹ REACH enumerators conducted a full sweep of all sites and camps (as per boundaries defined by ISCG) and used an Open Data Kit (ODK) form to log all key infrastructure observed during this sweep, with further details to be logged for WASH infrastructure. ⁴ Safe refers to fully covered latrines (i.e. a latrine with four walls, a roof and a door) ³ This farget is based on standards for the medium and long term (3 months +), for the immediate phase (0-3 months) it is 1000. ⁴ The distance is based on standards for the long term (6 months+), for the immediate phase (0-3 months) it is 750 metres and for the medium phase (3-6 months) 500 metres.




For more information, please contact REACH: bangladesh@reach-initiative.org





Sanitation

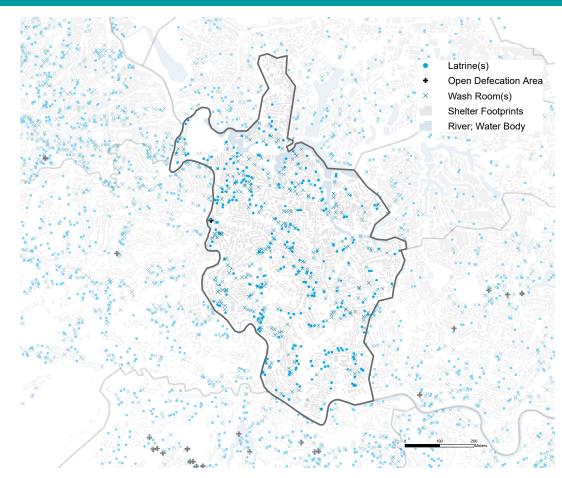

Latrine characteristics

% of functional/non-functional latrines



functional (non-full) latrines non-functional latrines



% of safe/unsafe latrines

Safe (roof, door, wall) Unsafe

% of latrines with/without lights



Key sectoral achievements

	Target	Current Round	Achievement
# of people per functional (non-full) latrine	max. 50 ⁴	38	
# of people per safe latrine	N/A	37	N/A
% of shelters with at least one functional latrine block within 50m	100%	98%	
% of functioning handpumps with no latrine within 10m	100%	65%	

Targets based on WASH Sector Standards/Indicators for Rohingya response, Sphere Minimum Standards/Indicators as well as DPHE Minimum Standards/ Indicators • Minimum standard/indicator reached, • 75%-99% minimum standard/indicator reached, • 50-74% minimum standard/indicator reached, • Less than 50% of minimum standard/indicator reached

⁴ This target is based on standards for the long term (6 months +), for the immediate phase (0-3 months) it is 100 and for the medium phase (3-6 months) 75.



