



## Summary

This profile provides an overview of water, sanitation and hygiene (WASH) infrastructure within Camp 14 in Ukhiya, Cox's Bazar. Primary data for this round was collected between 11 March - 2 April 2018.<sup>1</sup> Findings should be considered indicative only.

## Site Overview

# of individuals:	34181
# of households:	8069
# of shelters:	7078
# of individuals per shelter:	5


## Key WASH Infrastructure

# of latrines	1564
(% functional):	(93%)
% of safe latrines <sup>2</sup> :	96
# of handpumps	303
(% functional):	(73%)
# of washrooms:	560

## Location Map



## Access to Water

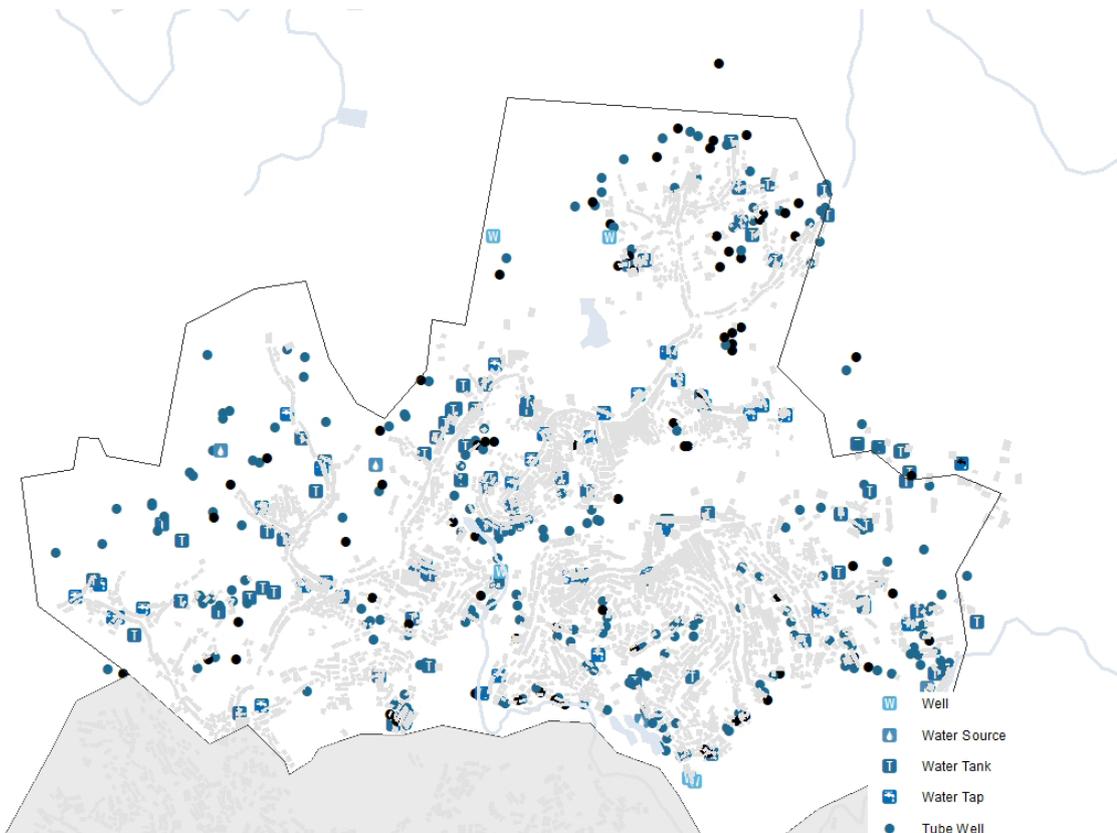

### Three most commonly identified types of water points, by functionality




### Key sectoral achievements

	Target	Current Round	Achievement
# of people per functional handpump	max. 250 <sup>3</sup>	113	
% of shelters with at least 1 functional handpump within 200m <sup>4</sup>	100%	100%	

Targets based on WASH Sector Standards/Indicators for the Rohingya response, Sphere Minimum Standards/Indicators as well as Department of Public Health and Environment (DPHE) Minimum Standards/Indicators ● Minimum standard/indicator reached, ● 75%-99% minimum standard/indicator reached, ● 50-74% minimum standard/indicator reached, ● Less than 50% of minimum standard/indicator reached

<sup>1</sup> REACH enumerators conducted a full sweep of all sites and camps (as per boundaries defined by ISCG) and used an Open Data Kit (ODK) form to log all key infrastructure observed during this sweep, with further details to be logged for WASH infrastructure. <sup>2</sup> Safe refers to fully covered latrines (i.e. a latrine with four walls, a roof and a door). <sup>3</sup> This target is based on standards for the medium and long term (3 months+), for the immediate phase (0-3 months) it is 1000. <sup>4</sup> The distance is based on standards for the long term (6 months+), for the immediate phase (0-3 months) it is 750 metres and for the medium phase (3-6 months) 500 metres.

## Sanitation

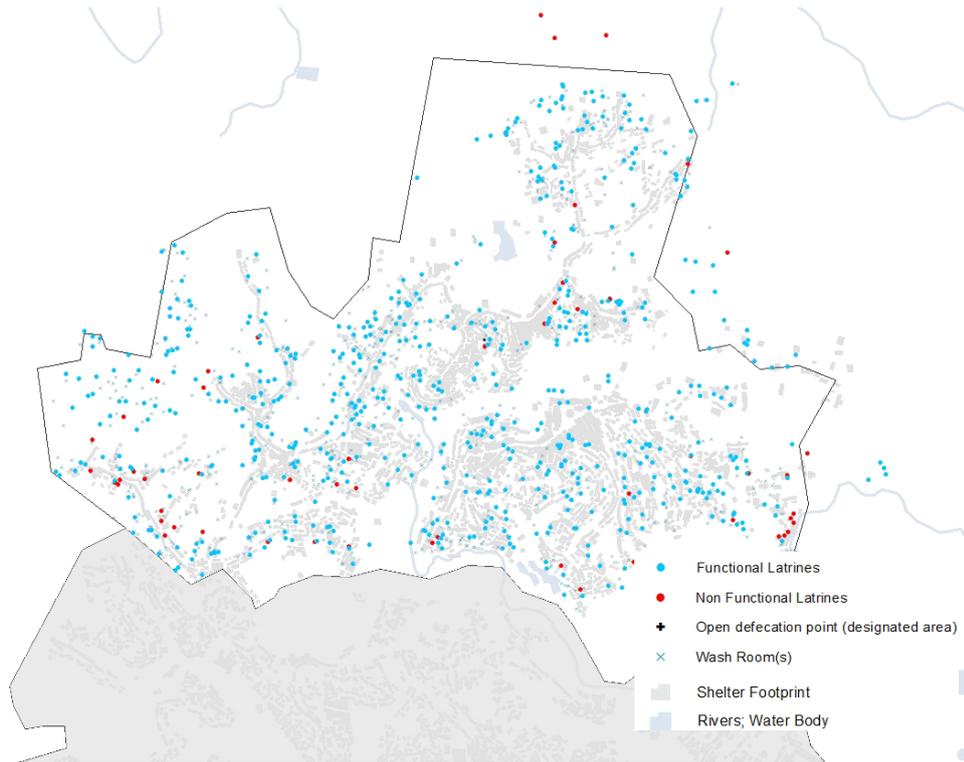


### Latrine characteristics

% of functional/non-functional latrines



**93%** Functional (non-full) latrines  
**7%** Non-functional latrines

% of safe/unsafe latrines



**96%** Safe (roof, door, wall)  
**4%** Unsafe

% of latrines with/without lights



**0%** With lights  
**100%** Without lights

### Key sectoral achievements

	Target	Current Round	Achievement
# of people per functional (non-full) latrine	max. 20 <sup>4</sup>	23	●
# of people per safe latrine	N/A	23	N/A
% of shelters with at least one functional latrine block within 50m	100%	91%	●
% of functioning handpumps with no latrine within 10m	100%	32%	●

Targets based on WASH Sector Standards/Indicators for Rohingya response, Sphere Minimum Standards/Indicators as well as DPHE Minimum Standards/Indicators ● Minimum standard/indicator reached, ● 75%-99% minimum standard/indicator reached, ● 50-74% minimum standard/indicator reached, ● Less than 50% of minimum standard/indicator reached

<sup>4</sup>This target is based on standards for the long term (6 months +), for the immediate phase (0-3 months) it is 100 and for the medium phase (3-6 months) 75.