



MOZAMBIQUE - Beira City

Muave - Unimproved Water Sources - As of 17 April 2019



2,906 buildings total*

414 buildings within 50m of an unimproved water source**

14% of neighbourhood within 50m of unimproved water sources

*according to UNOSAT-REACH analyst building count

**unimproved water sources are open wells, open water catchments and other unprotected water sources identified through a rapid infrastructure assessment of Beira by REACH. Other water sources are protected wells, motorized/hand pumped boreholes, tapstands, and municipal piped water. REACH was unable to map the piped water system due to its extent, so water analysis is focused on highlighting areas with unimproved sources.

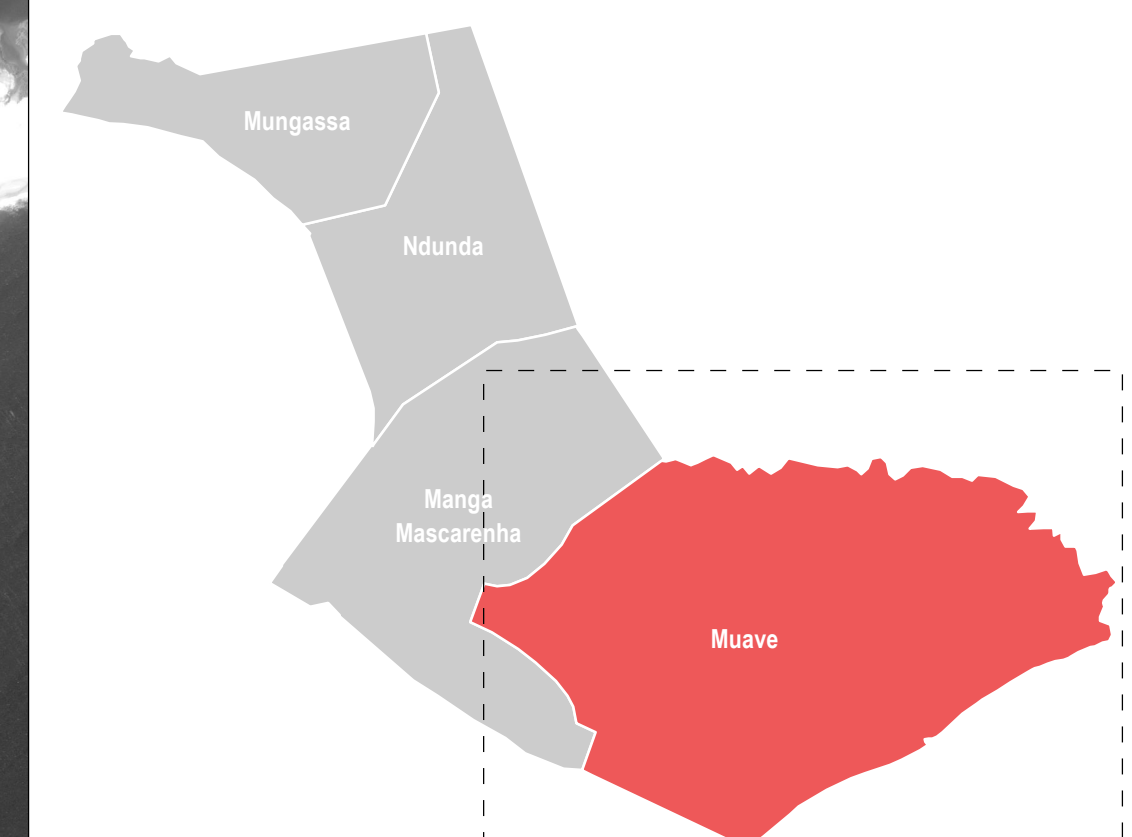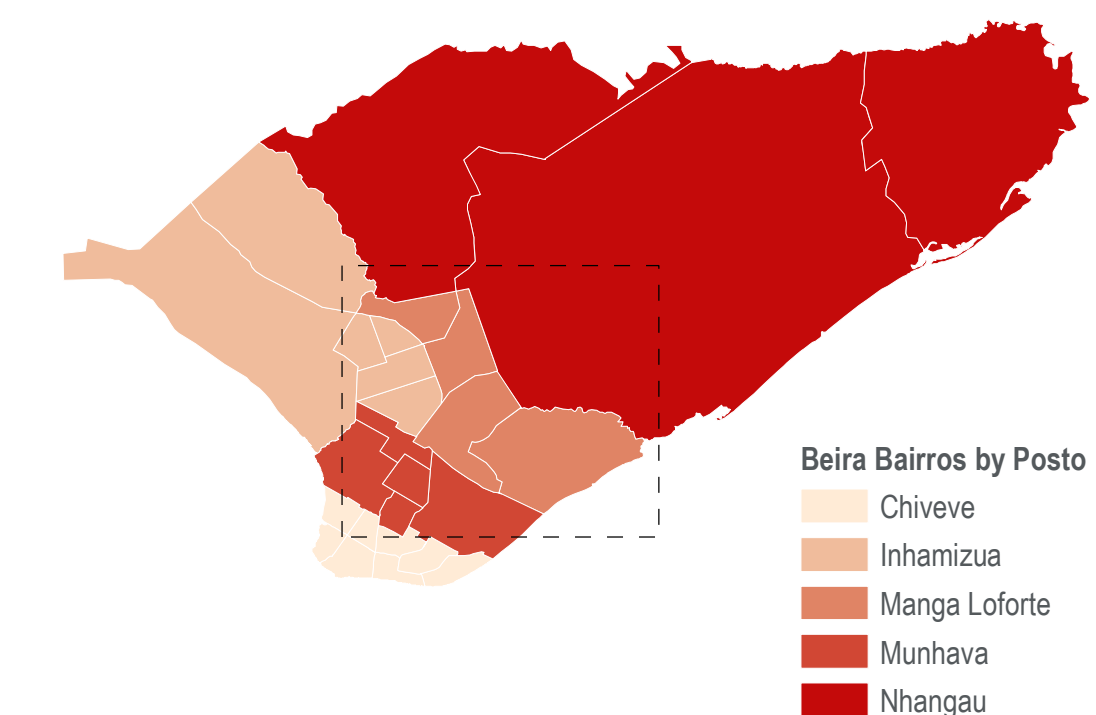

Legend

- Areas within 50m of unimproved water sources
- Bairros

